
The National Cancer Protection Gap

Attendee Resource Guide

Fireground Actions

Run every working fire like a hazmat scene: set zones, decon in the warm zone while still on air, and keep contaminated gear out of cabs and cars. Section numbers are from NFPA 1585 (2025).

Control zones

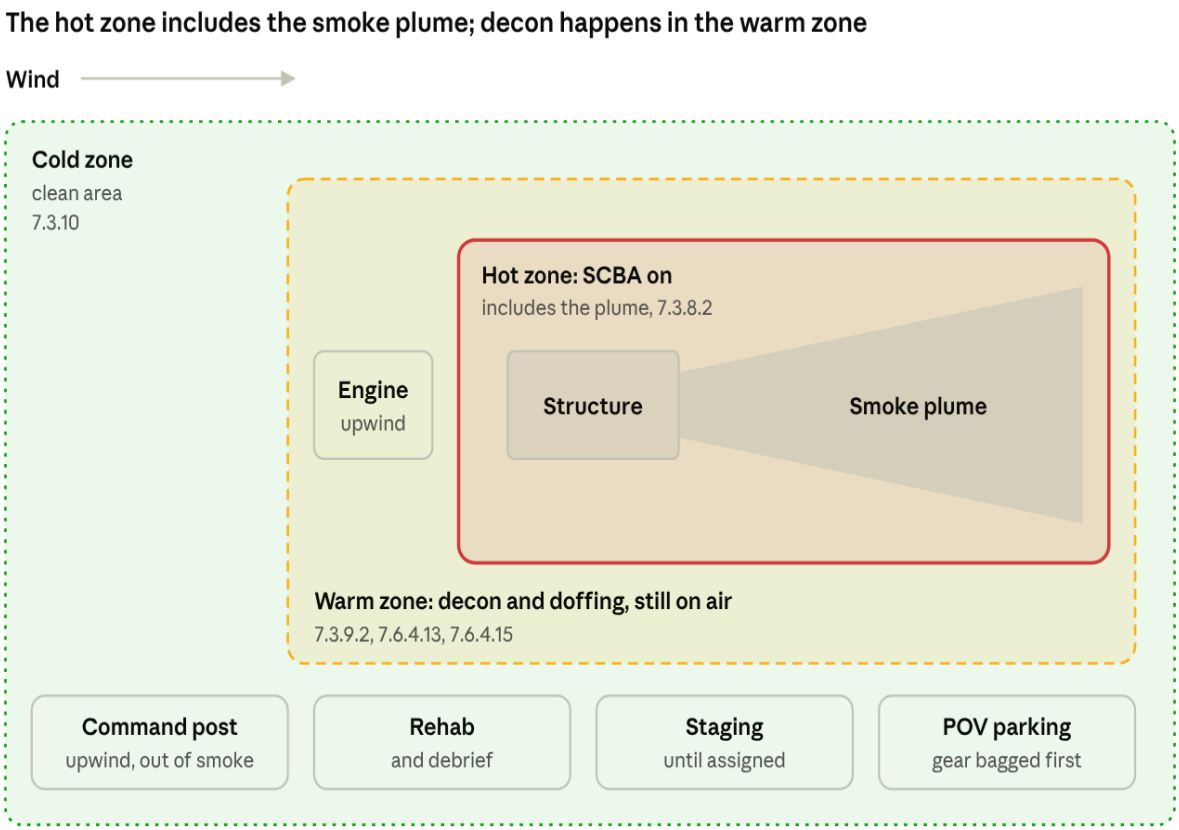

NFPA 1585 (2025) §7.3, §7.4 · plan view, not to scale

- The IC sets the zones and tells every member where the lines are (7.3.1 to 7.3.5).
- Put apparatus upwind with cabs shut. Position the pump panel, command and rehab vehicles to limit exposure (7.4.1, 7.4.2, 7.4.7).
- Exposed outside the hot zone: pump operators, ICs at an exposed command post, safety officers, RIT and on-deck crews, exterior crews, and anyone caught by a wind shift (A.7.4.5). They need exposure records too.